O.P.D. 1220 SEC. 4 P. 1

P-6129424

THIRD ANGLE PROJECTION

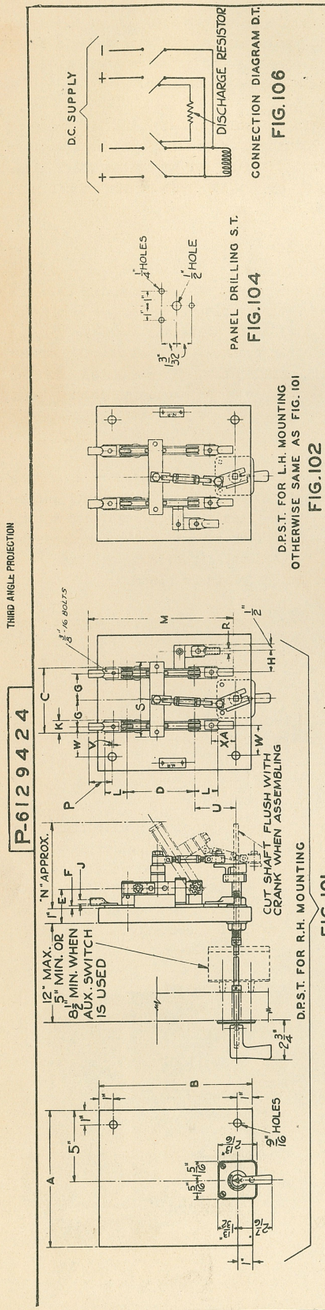

FIG. 101

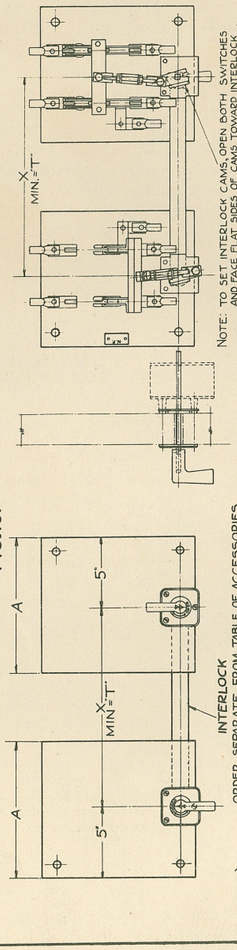

FIG. 103

NOTE: TO SET INTERLOCK CAMS, OPEN BOTH SWITCHES AND FACE FLAT SIDES OF CAMS TOWARD INTERLOCK

D.P.S.T. FOR L.H. MOUNTING OTHERWISE SAME AS FIG. 101

FIG. 102

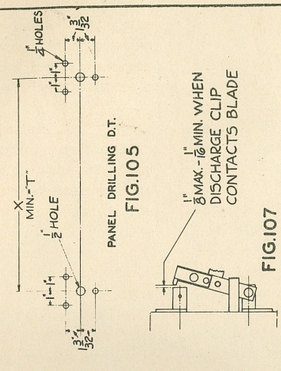

CONNECTION DIAGRAM D.T.

FIG. 106

PANEL DRILLING S.T.

FIG. 104

PANEL DRILLING D.T.

FIG. 105

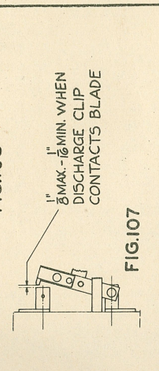

FIG. 107

TABLE OF ACCESSORIES				
	INTERLOCK	FITTINGS FOR PIPE MOUNTING	AUX. SWITCH	
X	DRAWING	GR.		
14"	M-6119188	1	2	K-6076953-G1
18"		2	3	
22"		3		
△ SPECIFIED	M-6119188, G-4 SPECIFY OF LENGTH OF CROSS BAR. LGTH. X-1½"			K-1943350 DISTANCE FROM ℄ OF PIPE TO BACK OF PANEL FOR D.T. BASED ON G-1 - 4½" FOR S.T. BASED ON G-4 - 6½" ORDER A.N.

INDEX AND OUTLINE
FIELD DISCHARGE KNIFE SWITCH
DEAD FRONT - TYPE LF-23 250 V.D.C.
Part Mod For INDOOR SWITCHING EQUIPMENT
Drawn By [illegible] Traced By [illegible] Date [illegible]
Designed By [illegible] Inspected [illegible]
GENERAL ELECTRIC CO.
PHILADELPHIA WORKS
P-6129424
4-41 FOLDER #40
RP-10070 -10

NOTICE TO PURCHASER
REFER TO CONTRACT FOR MATERIAL TO BE SUPPLIED BY THE GENERAL ELECTRIC COMPANY. THE NAMEPLATE RATING MUST NOT BE EXCEEDED OR INCREASED BY ANYTHING SHOWN UPON THIS DRAWING.

PART	POLE THROW	FIG.	AMP.	HOW USED	SWITCH DRWG.	GR.	A	B	C	D	E	F	G	H	J	K	L	M	N	P	R	S	T	V	W	XA	PANEL DRILLING	NET WEIGHTS
1		101	100	RIGHT HAND	D.L.6053063	1	9¾"	12"		2⅞"	5/16"		1⅞"	4 19/64"	2¼"	1¼"	6½"	1½"	4 19/64"										15" INCLUDING BASE
2		102		LEFT HAND		2				4 3/4"													5½"					
3	D.P. S.T.	101	200	RIGHT HAND	*	3	9¾"	12"		2⅞"	5/16"		1⅞"	6 25/64"	2¼"	1¼"	6½"	2"	6 25/64"				5"					FIG. 104	
4		102		LEFT HAND		4				4 3/4"																		
5		101	400	RIGHT HAND		5	10 1/2"	12¾"	5⅝"	5¼"	3"	7/16"	2"	1 15/16"	7 7/16"	1⅛"	2¼"	1¼"	7¼"	2¾"				5"					
6		102		LEFT HAND		6																						
7			100		D.L.6053063	7	12"	4 3/4"	4 3/4"	2⅞"	5/16"	1⅞"	2"	4 19/64"	2¼"	1¼"	6½"	1½"	4 19/64"										15" INCLUDING BASE
8	D.P. D.T.	103 & 106	200		*	8	12"	4 3/4"	4 3/4"	2⅞"	5/16"	1⅞"	2"	6 25/64"	2¼"	1¼"	6½"	2"	6 25/64"				5"					FIG. 105	20" INCLUDING BASE
9			400			9	10 1/2"	12¾"	5⅝"	5¼"	3"	7/16"	2"	1 15/16"	7 7/16"	1⅛"	2¼"	1¼"	7¼"	2¾"				5"						30" INCLUDING BASE
																												40" INCL. BASE

REVISIONS	
10	[illegible]
9	[illegible]
8	[illegible]
7	[illegible]
6	[illegible]
5	[illegible]
4	[illegible]
3	[illegible]
2	[illegible]
1	CHANGED PER L.S.T.

* INCLUDES OPERATING MECHANISM AND BASES. SELECT BASE MOUNTINGS AND INTERLOCK FROM TABLE OF ACCESSORIES

△ WHEN AUX. SWITCH IS ORDERED OMIT SHAFT FROM SWITCH D.L.

LOCKE INSULATOR CORPORATION

INTERNAL CORRESPONDENCE

Subject:

Referring to:

Baltimore, Md.
October 5, 1939

Mr. McCoy:

We are attaching herewith prints received from the General Electric Company, to be used in connection with the radio noise measuring circuit and accessories, our order B-69065.

Yours very truly,

E. V. CATHER

Purchasing Department

EVC:

nfb.

1.2 1.4

:022

136
55
81